

General information

Installation and maintenance:

For European member countries of GENELEC, shall standard EN 60079-14 and EN 60079-17 be considered.


For countries members of IECEx shall standard IEC 60079-14 and IEC 60079-17 be considered.

For other countries shall applicable national regulation be considered.

The products fulfill the following standards:

EN 60079-0:2012, EN 60079-31:2009

IEC 60079-0:2011, IEC 60079-31:2008

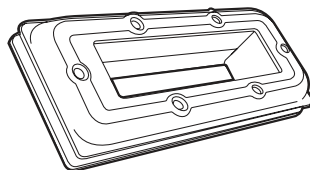

Installation instructions

CF 16 Ex frame

Aperture dimensions and max wall thickness

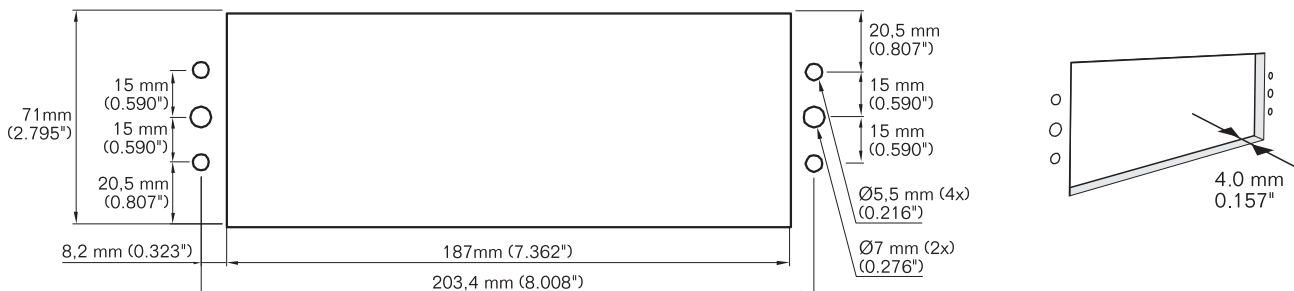


Fig. 1



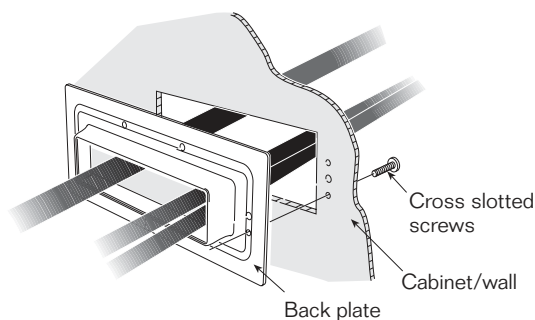



Fig. 2

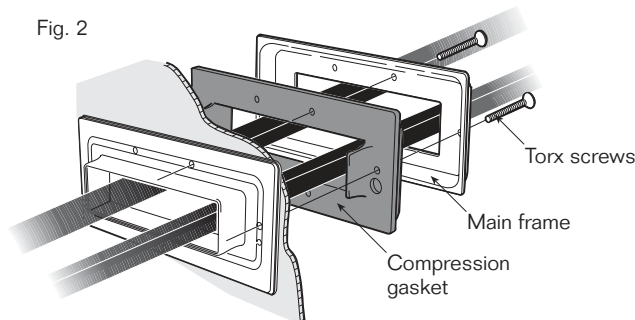


Installation

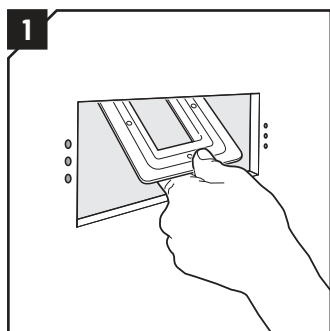


Insert the back plate from the installation side.

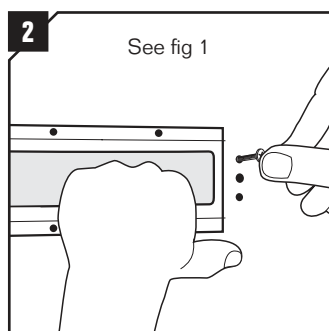


Fix the back plate with the two cross slotted screws.

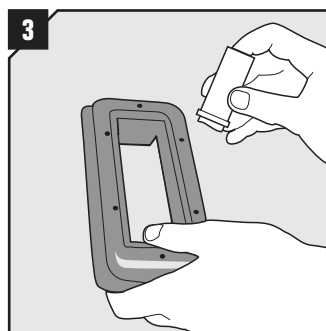


Thoroughly lubricate the compression gasket with Roxtec Lubricant.

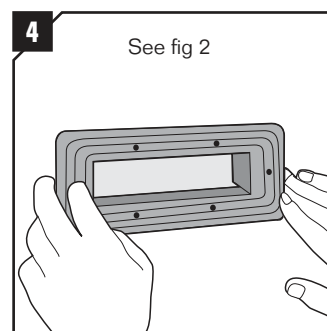


Place the compression gasket from the installation side.

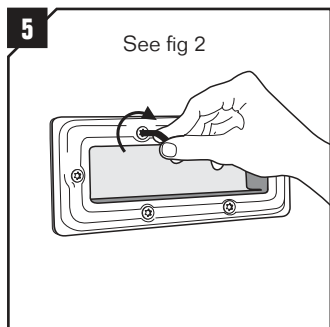


Fix the main frame parts loosely over the compression gasket with the torx screws.

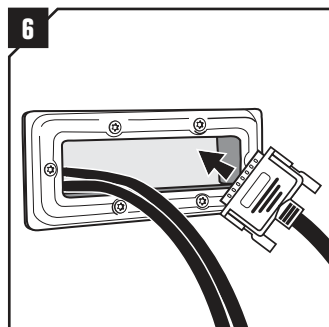


Insert the cables through the frame.

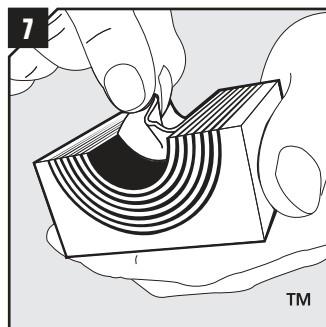


Adapt modules which are to hold cables or pipes by peeling off layers until you reach the gap seen in pic. 8. The halves may not differ by more than one layer.

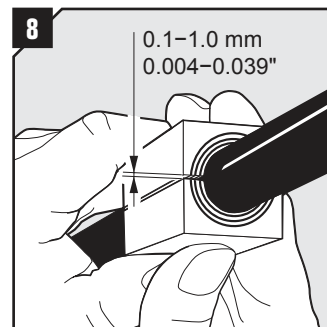


Achieve a 0.1-1.0 mm gap between the two halves when held against the cable/pipe. Use the Ex Gap Gauge.

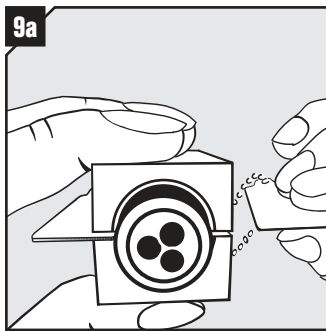


Measure the gap with the Ex Gap Gauge by holding blade one in one gap and checking the other with blade two.

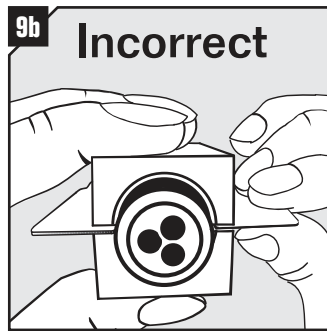


If the gap is too big, the gauge will slip in easily.

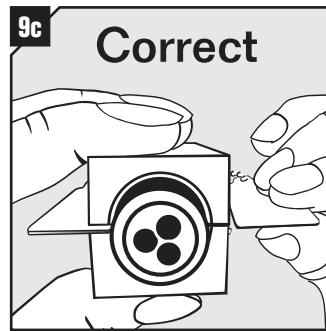


If the gap is correct, there will be no room for blade two.

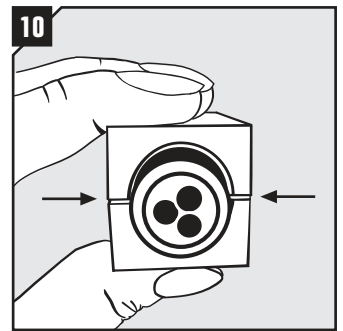


When checking without the gauge, there shall be a visual gap.

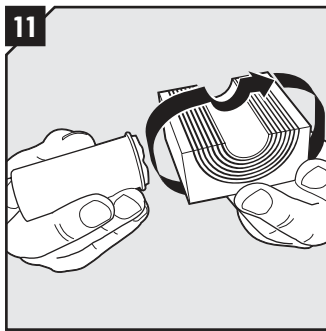


Lubricate all modules for the frame thoroughly, both the inside and the outside surfaces.

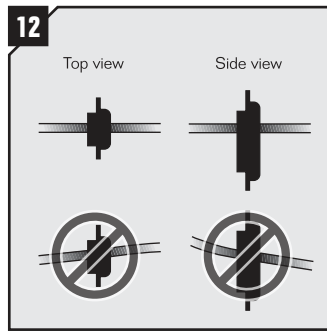

Note that cables shall go straight through the frame.

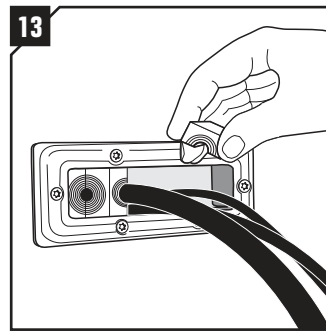

Insert the modules from the installation side.

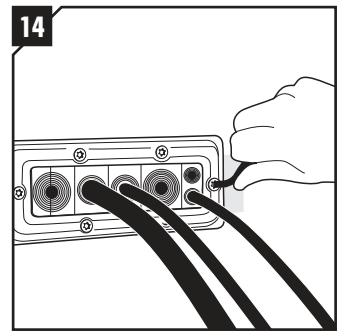

Tighten the torx screws when all modules are in place. Always start with the short sides. Minimum 8 Nm.

Note

- An incorrectly adapted module shall be replaced (layers shall not be reused).
- Temperature range -60 to +80 °C.
- Permitted Roxtec modules: CM Ex type.
- You find EC Type examination certificate at www.roxtec.com, or contact your local Roxtec supplier.

The following conditions for safe use shall be considered according to the ATEX EC Type Examination certificate and the IECEx Certificate of Conformity:


1. For maintaining the explosion protection, the installation instructions that accompany the products shall be considered.
2. Only cable for fixed installation is permitted for the cable entry.
3. For optimum reliability wait 24 hours or longer after installation before exposing the cables/pipes to strain or pressure.

Disassembly

Reverse order

Frame labels

XXXX = Year of manufacture

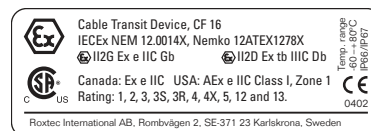

Standard adaptable modules Ex

Module	Number of cables/pipes	For cable/pipe diameter a-b (mm)	
CM 15w40 Ex	3	0+ 3.5-10.5	0+ 0.138-0.413
CM 20 Ex	1	0+ 4.0-14.5	0+ 0.157-0.571
CM 20w40 Ex	2	0+ 3.5-16.5	0+ 0.138-0.650
CM 30w40 Ex	1	0+ 10.0-25.0	0+ 0.394-0.984
CM 40 Ex	1	0+ 21.5-34.5	0+ 0.846-1.358
CM 40 10-32 Ex	1	0+ 9.5-32.5	0+ 0.374-1.280

Solid compensation modules Ex

Module
CM 5w40/0 Ex
CM 10w40/0 Ex
CM 20/0 Ex
CM 40/0 Ex

Single diameter modules Ex

Module
CM 20/14 Ex
CM 20/15 Ex
CM 20/16 Ex
CM 40/34 Ex
CM 40/36 Ex

Attestation of Conformity for Components

We, Roxtec International AB, declare under sole responsibility that the products to which this declaration relates is in accordance with the provisions of the directive 94/9/EC and is in conformity with the following harmonized standards: EN 60079-0:2012, EN 60079-7:2007, EN 60079-31:2009

Cable Transit Device:

G...W, S, S...S0..., SRC, SK, S BTB, S...WM, SF...W, R...W, RO...W, RS...W, B...C-Ex

EC-type Examination Certificate:

Nemko 12ATEX1279U

Marking:

CE 0402 II 2G Ex e IIC Gb
CE 0402 II 2D Ex tb IIIC Db

Certificate issued by:

SP Sveriges Tekniska Forskningsinstitut
Box 857,
501 15 BORÅS

Karlskrona 2015-04-20

Roxtec International AB
Box 540
371 23 Karlskrona

Jörgen Åkesson
Explosion Protection Manager



Declaration of Conformity



We, Roxtec International AB, declare under sole responsibility that the products to which this declaration relates is in accordance with the provisions of the directive 94/9/EC and is in conformity with the following harmonized standards: EN 60079-0:2012, EN 60079-7:2007, EN 60079-31:2009

Cable Transit Device:

CF 16, CF 8/32, G-, G BG-, SF, SF BG-, R...B, RO...B, RS...B, B...B, C RS-T-Ex

EC Type Examination Certificate:

Nemko 12ATEX1278X

Cable Transit Device:

G...W, S, S...S0..., S...WM, SRC, SK, S BTB, SF...W, R...W, RO...W, RS...W, B...C-Ex

EC Type Examination Certificate:

Nemko 12ATEX1279U

Marking:

CE 0402 II 2G Ex e IIC Gb
CE 0402 II 2D Ex tb IIIC Db

Certificate issued by:

SP Sveriges Tekniska Forskningsinstitut
Box 857,
501 15 BORÅS

Karlskrona 2015-04-20

Roxtec International AB
Box 540
371 23 Karlskrona

Jörgen Åkesson
Explosion Protection Manager





**THORNE &
DERRICK
INTERNATIONAL**

Thorne & Derrick
+44 (0) 191 410 4292
www.powerandcables.com

DISCLAIMER

"The Roxtec cable entry sealing system ("the Roxtec system") is a modular-based system of sealing products consisting of different components. Each and every one of the components is necessary for the best performance of the Roxtec system. The Roxtec system has been certified to resist a number of different hazards. Any such certification, and the ability of the Roxtec system to resist such hazards, is dependent on all components that are installed as a part of the Roxtec system. Thus, the certification is not valid and does not apply unless all components installed as part of the Roxtec system are manufactured by or under license from Roxtec ("authorized manufacturer"). Roxtec gives no performance guarantee with respect to the Roxtec system, unless (i) all components installed as part of the Roxtec system are manufactured by an authorized manufacturer and (ii) the purchaser is in compliance with (a), and (b), below.

(a) During storage, the Roxtec system or part thereof, shall be kept indoors in its original packaging at room temperature.

(b) Installation shall be carried out in accordance with Roxtec installation instructions in effect from time to time.

The product information provided by Roxtec does not release the purchaser of the

Roxtec system, or part thereof, from the obligation to independently determine the suitability of the products for the intended process, installation and/or use. Roxtec gives no guarantee for the Roxtec system or any part thereof and assumes no liability for any loss or damage whatsoever, whether direct, indirect, consequential, loss of profit or otherwise, occurred or caused by the Roxtec systems or installations containing components not manufactured by an authorized manufacturer and/or occurred or caused by the use of the Roxtec system in a manner or for an application other than for which the Roxtec system was designed or intended.

Roxtec expressly excludes any implied warranties of merchantability and fitness for a particular purpose and all other express or implied representations and warranties provided by statute or common law. User determines suitability of the Roxtec system for intended use and assumes all risk and liability in connection therewith. In no event shall Roxtec be liable for indirect, consequential, punitive, special, exemplary or incidental damages or losses."



Roxtec International AB
Box 540, 371 23 Karlskrona, SWEDEN
PHONE +46 455 36 67 00, FAX +46 455 820 12
EMAIL info@roxtec.com, www.roxtec.com