


Document type:						
B	CABLE					
B.1	DESIGN DRAWINGS, DATA SHEETS					
Project: West of Duddon Sands Offshore Wind Farm 34 kV Submarine Cable Supply			Nexans document number: 11.31.016-B.1-003		Issue: AB1	
Document title: Cable Drawing 3x1x630 mm² - drum			Pages: 03 including this cover sheet excluding attachments		Category: EXT	
Scope: This document contains the drawings / data for the above mentioned cable.						
AB1	11.04.2014	Issued for As Built	PW / EWPP	EWPP	TM	PW
Issue:	Date:	Document Status:	Prepared:	Checked:	Approved:	Released:
Company:			Company's contract no.:			
 			48 0000 7001 Array Cables / WDS			
CONFIDENTIAL. All rights reserved. Passing on or copying of this document, use and communication of its contents are not permitted without prior written authorization from Nexans Germany			Communication Note / RDS-PP : WDS01V20AAF EDA003			

Revision Description Sheet

Rev.	Para.	Revision Description
AB1		Issued for Final Documentation

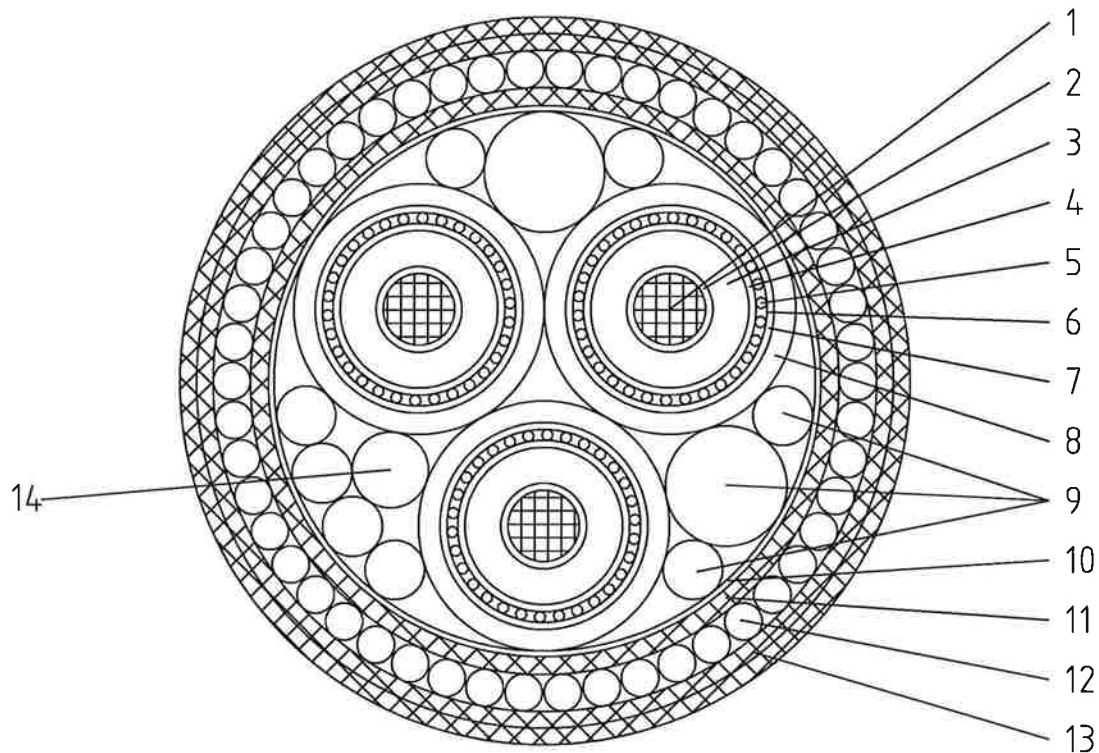

No. No. No. Nr.	Designation Désignation Caracteristica Bezeichnung	Material Matériaux Material Material	Measurements Dimensions Dimensiones Abmessungen mm	Diameters, approx. Diamètre, approché Diámetro, aprox. Durchmesser, ca. mm
1	conductor	copper wires, circular stranded compacted longitudinally watertight, semi-cond. taped	61 wires	30.6 (bare)
2	conductor screening	extruded semi-conductive compound	Wd min. 0.5	
3	insulation	XLPE	Wd nom. 8.0	48.5
4	insulation screening	extruded semi-conductive compound and semi-conductive tapes	Wd min. 0.5	
5	screen	copper wires and counter helix tape	25 mm ²	
6	sealing	swelling powder (in the gaps)		
7	} laminated core sheath	Al-tape bonded to		
8		extruded PE-sheath and outer electrode	Wd 2.7	58
9	filler	polypropylene strings		
10	binder	PET foils		
11	bedding	polypropylene yarn	Wd appr. 2.5	
12	armouring	round steel wires, galvanized, covered with bituminous compound	Ø 4.75	
13	serving	Hessian tapes and polypropylene yarn	Wd appr. 4	147
14	fibre optic cable			
Indented marking of sheath (no. 8)		L1, L2 or L3, - NEXANS -, 1 x 630/25 20/34 kV, year, meter markings, code-no.		
Core colour code: without Couleur des conducteurs isolés: Color de los conductores: Aderfarben:		Colour of oversheath: Couleur de la gaine extérieure: Color del revestimiento exterior: Farbe des Außenmantels:		Wd = Wall thickness Épaisseur Espesor Wanddicke
	XLPE insulated submarine cable		Tag 19.10.2011	Gez. Dötzer
	type (F)2XS(FL)2Y>c<RAA 3x1x630 RM/25 + FO 20/34 kV to IEC 60502-2		Gepr. Hoyer	AC MI-0665 DWG PM.ME-3480 p65
HANNOVER		U _m = 36 kV		PM.ME.A4.3480.01

4/2V